
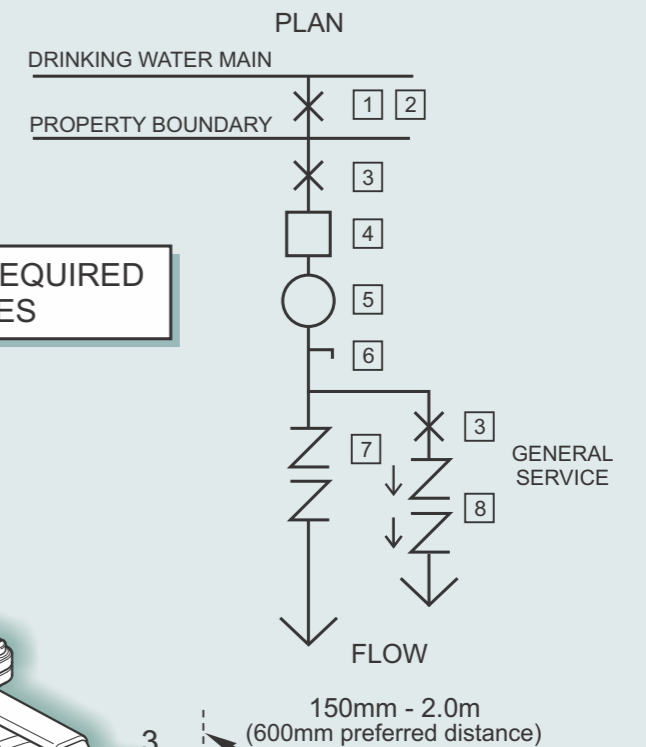


PROPERTY OWNER'S RESPONSIBILITY FROM WATER MAIN EXCEPT FOR WATER METER

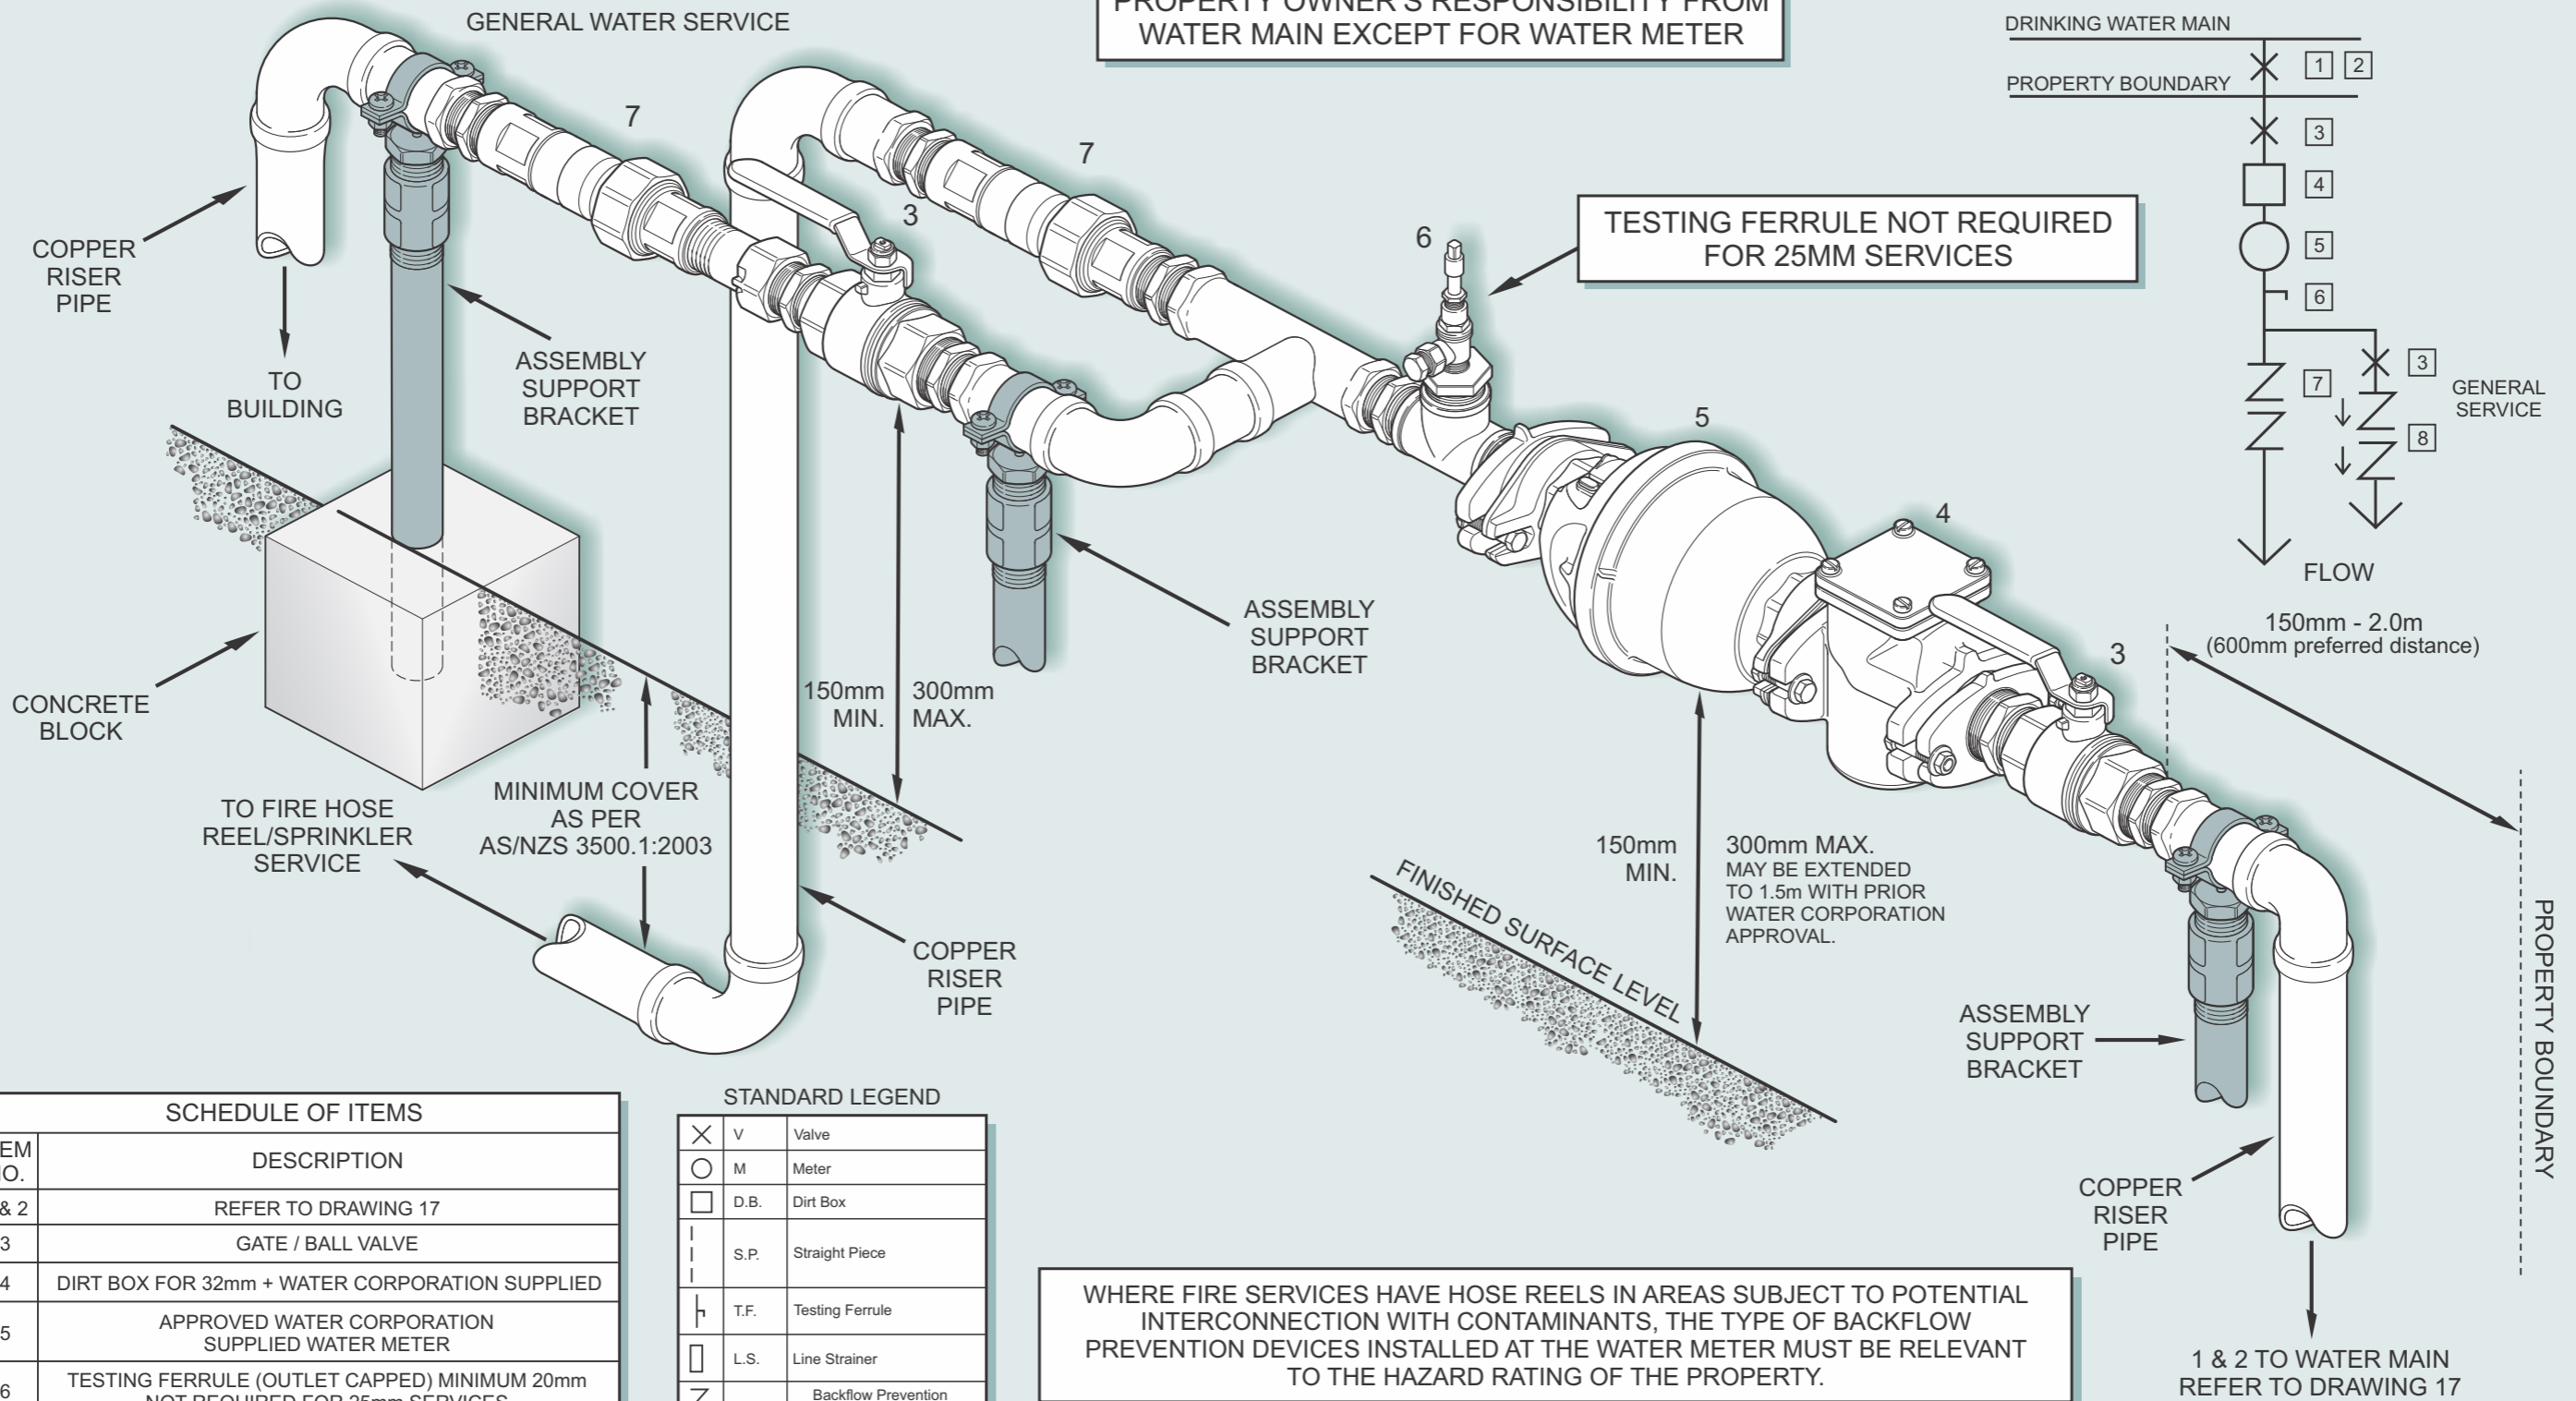

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	GATE / BALL VALVE
4	DIRT BOX FOR 32mm + WATER CORPORATION SUPPLIED
5	APPROVED WATER CORPORATION SUPPLIED WATER METER
6	TESTING FERRULE (OUTLET CAPPED) MINIMUM 20mm NOT REQUIRED FOR 25mm SERVICES
7	APPROPRIATE APPROVED BACKFLOW PREVENTION DEVICE
METERS 50mm AND ABOVE TO BE INDEPENDENTLY SUPPORTED FROM PIPE WORK	
SEE GENERAL NOTES FOR FURTHER INFORMATION	

STANDARD LEGEND		
	V	Valve
	M	Meter
	D.B.	Dirt Box
	S.P.	Straight Piece
	T.F.	Testing Ferrule
	L.S.	Line Strainer
	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
	S.C.V.T	Single Check Valve Testable
	S.C.D.A.T.	Single Check Detector Assembly Testable

WHERE FIRE SERVICES HAVE HOSE REELS IN AREAS SUBJECT TO POTENTIAL INTERCONNECTION WITH CONTAMINANTS, THE TYPE OF BACKFLOW PREVENTION DEVICES INSTALLED AT THE WATER METER MUST BE RELEVANT TO THE HAZARD RATING OF THE PROPERTY.